



CIVIL GEOTECHNICAL SERVICES
ABN 26 474 013 724
PO Box 678 Croydon Vic 3136
Telephone: 9723 0744 Facsimile: 9723 0799

29th February 2024

Our Reference: 23850:NB1805

Winslow Constructors Pty Ltd
50 Barry Road
CAMPBELLFIELD VIC 3061

Dear Sirs/Madams,

RE: LEVEL 1 EARTHWORKS INSPECTION AND TESTING
SEVENTH BEND – STAGE 14 (MELTON SOUTH)

Please find attached our Report No's 23850/R001 to 23850/R006 which relate to the field density testing that was conducted within the filled allotments at the above subdivision. The level 1 inspections and associated field density testing commenced in October 2023 and was completed in November 2023.

The inspections and testing of the earthworks was undertaken in general accordance with the Level 1 requirements of AS 3798 - Guidelines on Earthworks for Commercial and Residential Developments.

The site inspection and testing was performed by experienced geotechnicians from this office. Any areas that were deemed unsatisfactory were reworked and retested under their supervision. The testing was performed to the relevant Australian Standards and the accompanying test reports carry NATA endorsement. The attached compaction results, which were located randomly throughout the fill profile, are considered to be representative of the bulk fill materials that were placed across the reported allotments by Winslow Constructors during the aforementioned period. The approximate locations of the field density tests can be seen on the attached plan (Figure 1).

We are of the view that the bulk fill materials that have been placed across the reported allotments by Winslow Constructors during the aforementioned period can be considered as having been placed in a controlled manner to a minimum density ratio of 95% (standard compactive effort).



Please contact the undersigned if you require any additional information.

Civil Geotechnical Services

A handwritten signature in blue ink, appearing to read 'Nick Brock', is written over a faint circular stamp.

Nick Brock

FIGURE 1

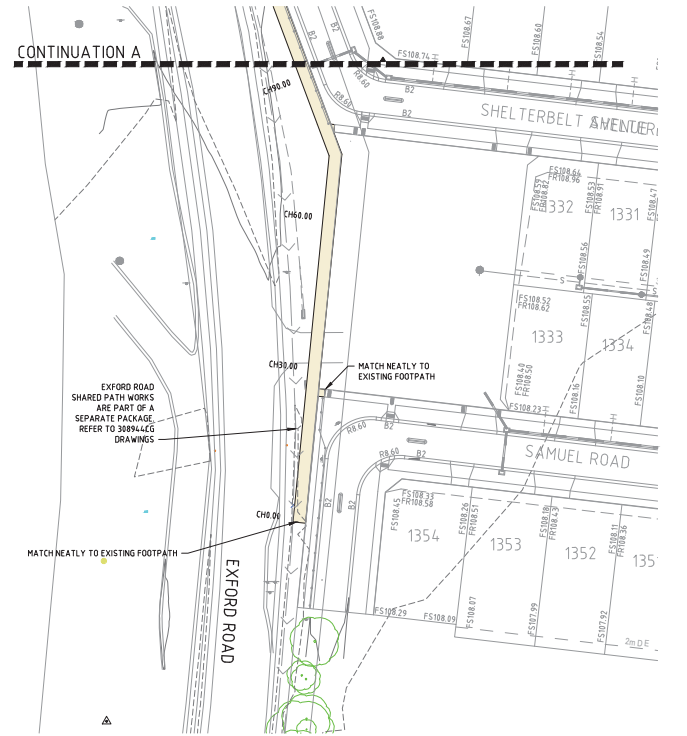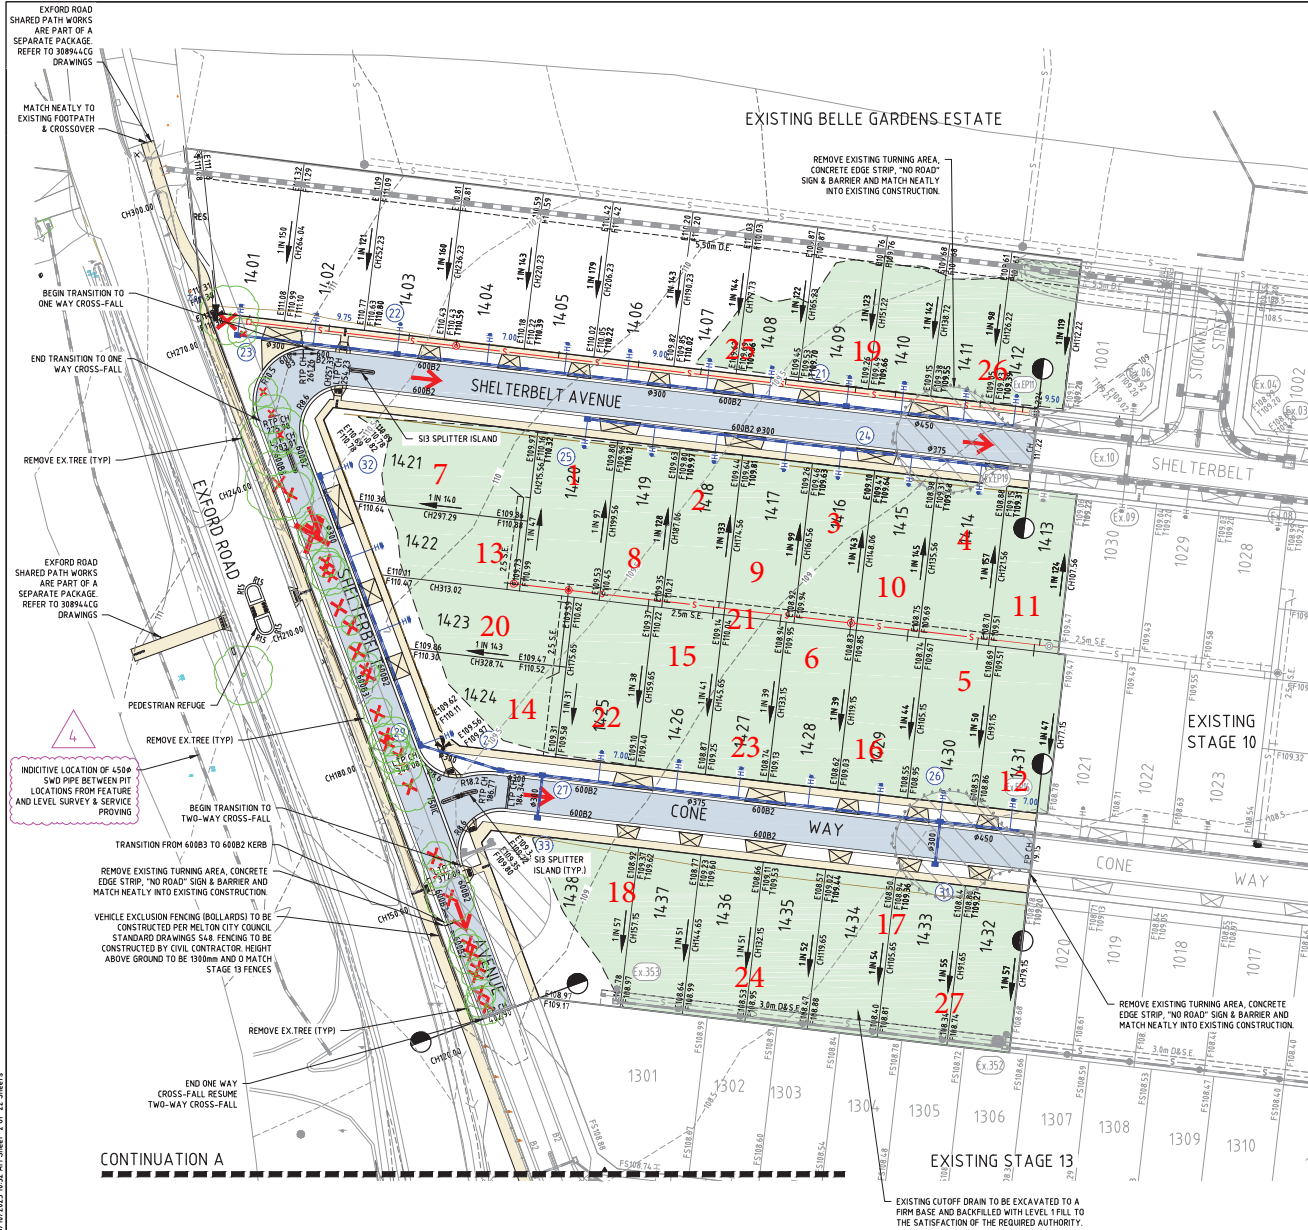

Approximate field density test location



CONTRACTOR TO PROVIDE SWMS FOR WORKING IN PROXIMITY OF EX ROAD & SERVICES

WARNING
BEWARE OF UNDERGROUND/OVERHEAD SERVICES
THE LOCATION OF SERVICES ARE APPROXIMATE ONLY AND THEIR EXACT POSITION SHOULD BE PROVEN ON SITE. NO GUARANTEE IS GIVEN THAT ALL EXISTING SERVICES ARE SHOWN. SPECIAL CONSIDERATION SHOULD BE GIVEN TO CONSTRUCTION PROCEDURES UNDER OVERHEAD ELECTRICITY TRANSMISSION LINES.

4	ADDITIONAL NOTE	M.H.	18/10/23
3	HOUSE DRAINS & SEWER PROPERTY CONNECTION OFFSETS AMENDED	M.H.	17/08/23
2	KERB TYPE AMENDED	M.H.	12/07/23
1	ISSUED FOR CONSTRUCTION	M.H.	31/05/23
D	COUNCIL AMENDMENTS	M.H.	04/05/23
C	FOOTPATH ADDED ALONG EXFORD ROAD	M.H.	17/04/23
B	AMENDED CROSSOVERS 1422-1424 & ADDED EXCLUSION FENCE	M.H.	24/08/22
A	ISSUED FOR APPROVAL	M.H.	20/12/21
Rev	Amendments	Approved	Date



© Spiire Australia Pty Ltd All Rights Reserved
This document is produced by Spiire Australia Pty Ltd solely for the benefit of and use by the client in accordance with the terms of the contract. Spiire Australia Pty Ltd does not warrant that it assumes any responsibility or liability whatsoever to any third party arising out of any use or reliance by that party on the content of this document.

spiire
L6 414 LA TROBE STREET PO BOX 16084 MELBOURNE
VICTORIA 3007 AUSTRALIA T 61 3 9993 7888
spiire.com.au ABR NS 050 029 635

Designed
O. TRAORE
Authorised
M. HOLMES

Checked
J. KOEHLER
Date
MAY 2023

SEVENTH BEND
STAGE 14
ROAD AND DRAINAGE
FACE PLAN
MELTON CITY COUNCIL
EXFORD ROAD MANAGEMENT PTY LTD

CONSTRUCTION **308944CR200** 4



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R001
 Date Issued 01/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	AM
Project	SEVENTH BEND - STAGE 14	Date tested	24/10/23
Location	MELTON SOUTH	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 15:00
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	1	2	3	-	-	-
Location	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1			
Approximate depth below FSL						
Measurement depth	mm	175	175	175	-	-
Field wet density	t/m ³	1.81	1.81	1.79	-	-
Field moisture content	%	22.3	22.1	22.9	-	-

Test procedure AS 1289.5.7.1

Test No	1	2	3	-	-	-
Compactive effort	Standard					
Oversize rock retained on sieve	mm	19.0	19.0	19.0	-	-
Percent of oversize material	wet	0	0	0	-	-
Peak Converted Wet Density	t/m ³	1.84	1.84	1.81	-	-
Adjusted Peak Converted Wet Density	t/m ³	-	-	-	-	-
Optimum Moisture Content	%	21.5	22.5	23.5	-	-

Moisture Variation From Optimum Moisture Content	1.0% wet	0.5% dry	0.5% dry	-	-	-
--	----------	----------	----------	---	---	---

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD})	%	98.5	98.5	99.0	-	-
-----------------------------------	---	------	------	------	---	---

Material description

No 1 - 3 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R002
 Date Issued 01/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	AM
Project	SEVENTH BEND - STAGE 14	Date tested	25/10/23
Location	MELTON SOUTH	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 10:31
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	4	5	6	-	-	-
Location	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1			
Approximate depth below FSL						
Measurement depth	mm	175	175	175	-	-
Field wet density	t/m ³	1.84	1.85	1.85	-	-
Field moisture content	%	22.6	20.0	20.8	-	-

Test procedure AS 1289.5.7.1

Test No	4	5	6	-	-	-
Compactive effort	Standard					
Oversize rock retained on sieve	mm	19.0	19.0	19.0	-	-
Percent of oversize material	wet	0	0	0	-	-
Peak Converted Wet Density	t/m ³	1.89	1.89	1.91	-	-
Adjusted Peak Converted Wet Density	t/m ³	-	-	-	-	-
Optimum Moisture Content	%	22.5	19.5	21.0	-	-

Moisture Variation From Optimum Moisture Content	0.0%	0.5% wet	0.0%	-	-	-
--	------	----------	------	---	---	---

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD})	%	97.5	97.5	97.0	-	-
-----------------------------------	---	------	------	------	---	---

Material description

No 4 - 6 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R003
 Date Issued 21/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Tested by AM
 Date tested 27/10/23
 Checked by JHF

Client WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)
 Project SEVENTH BEND - STAGE 14
 Location MELTON SOUTH

Feature	EARTHWORKS	<i>Layer thickness</i>	200 mm	<i>Time:</i> 11:54
----------------	-------------------	------------------------	--------	--------------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	7	8	9	10	11	12
<i>Location</i>	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1
<i>Approximate depth below FSL</i>						
<i>Measurement depth</i> mm	175	175	175	175	175	175
<i>Field wet density</i> t/m ³	2.03	1.99	1.94	1.88	1.85	1.81
<i>Field moisture content</i> %	22.8	20.2	22.5	21.4	21.6	19.8

Test procedure AS 1289.5.7.1

Test No	7	8	9	10	11	12
<i>Compactive effort</i>	Standard					
<i>Oversize rock retained on sieve</i> mm	19.0	19.0	19.0	19.0	19.0	19.0
<i>Percent of oversize material</i> wet	0	0	0	0	0	0
<i>Peak Converted Wet Density</i> t/m ³	2.12	2.10	2.01	1.93	1.90	1.90
<i>Adjusted Peak Converted Wet Density</i> t/m ³	-	-	-	-	-	-
<i>Optimum Moisture Content</i> %	25.0	20.0	23.5	21.0	23.0	20.5

<i>Moisture Variation From Optimum Moisture Content</i>	2.0% dry	0.0%	1.0% dry	0.0%	1.5% dry	1.0% dry
---	----------	------	----------	------	----------	----------

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R_{HD}) %	96.0	95.0	96.5	97.5	97.5	95.5
---	-------------	-------------	-------------	-------------	-------------	-------------

Material description

No 7 - 12 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R004
 Date Issued 21/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	AM
Project	SEVENTH BEND - STAGE 14	Date tested	31/10/23
Location	MELTON SOUTH	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 12:18
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	13	14	15	16	17	18	
Location	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	
Approximate depth below FSL							
Measurement depth	mm	175	175	175	175	175	
Field wet density	t/m ³	2.02	2.03	2.02	1.99	1.98	2.00
Field moisture content	%	20.0	22.6	21.6	20.9	22.5	20.0

Test procedure AS 1289.5.7.1

Test No	13	14	15	16	17	18	
Compactive effort	Standard						
Oversize rock retained on sieve	mm	19.0	19.0	19.0	19.0	19.0	
Percent of oversize material	wet	0	0	0	0	0	
Peak Converted Wet Density	t/m ³	2.00	2.06	2.05	2.03	2.01	2.04
Adjusted Peak Converted Wet Density	t/m ³	-	-	-	-	-	-
Optimum Moisture Content	%	22.0	23.5	22.0	21.0	24.0	20.5

Moisture Variation From Optimum Moisture Content	2.0% dry	1.0% dry	0.5% dry	0.0%	1.5% dry	0.5% dry
--	----------	----------	----------	------	----------	----------

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD})	%	101.0	98.5	98.5	98.0	99.0	98.5
-----------------------------------	---	-------	------	------	------	------	------

Material description

No 13 - 18 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R005
 Date Issued 09/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	AM
Project	SEVENTH BEND - STAGE 14	Date tested	01/11/23
Location	MELTON SOUTH	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 11:17
---------	------------	-----------------	--------	-------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	19	20	21	22	23	24	
Location	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1	
Approximate depth below FSL							
Measurement depth	mm	175	175	175	175	175	
Field wet density	t/m ³	2.03	1.99	1.95	2.20	2.14	2.22
Field moisture content	%	22.5	18.7	20.7	18.8	18.6	20.6

Test procedure AS 1289.5.7.1

Test No	19	20	21	22	23	24	
Compactive effort	Standard						
Oversize rock retained on sieve	mm	19.0	19.0	19.0	19.0	19.0	
Percent of oversize material	wet	0	0	0	0	0	
Peak Converted Wet Density	t/m ³	2.11	2.07	1.98	2.29	2.19	2.27
Adjusted Peak Converted Wet Density	t/m ³	-	-	-	-	-	-
Optimum Moisture Content	%	22.5	18.5	21.0	18.5	18.0	20.5

Moisture Variation From Optimum Moisture Content	0.0%	0.0%	0.0%	0.5% wet	0.5% wet	0.0%
--	------	------	------	----------	----------	------

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R _{HD})	%	96.0	96.5	98.5	96.0	97.5	98.0
-----------------------------------	---	------	------	------	------	------	------

Material description

No 19 - 24 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry



COMPACTION ASSESSMENT

Job No 23850
 Report No 23850/R006
 Date Issued 13/11/23

CIVIL GEOTECHNICAL SERVICES

6 - 8 Rose Avenue, Croydon 3136

Client	WINSLOW CONSTRUCTORS PTY LTD (CAMPBELLFIELD)	Tested by	AM
Project	SEVENTH BEND - STAGE 14	Date tested	08/11/23
Location	MELTON SOUTH	Checked by	JHF

Feature	EARTHWORKS	Layer thickness	200 mm	Time: 10:30
----------------	-------------------	------------------------	--------	--------------------

Test procedure AS 1289.2.1.1 & 5.8.1

Test No	25	26	27	-	-	-
Location	REFER TO FIGURE 1	REFER TO FIGURE 1	REFER TO FIGURE 1			
Approximate depth below FSL						
Measurement depth	mm	175	175	175	-	-
Field wet density	t/m ³	1.87	1.88	1.91	-	-
Field moisture content	%	22.8	21.1	21.6	-	-

Test procedure AS 1289.5.7.1

Test No	25	26	27	-	-	-
Compactive effort	Standard					
Oversize rock retained on sieve	mm	19.0	19.0	19.0	-	-
Percent of oversize material	wet	0	0	0	-	-
Peak Converted Wet Density	t/m ³	1.91	1.92	1.89	-	-
Adjusted Peak Converted Wet Density	t/m ³	-	-	-	-	-
Optimum Moisture Content	%	25.5	23.0	23.5	-	-

Moisture Variation From Optimum Moisture Content	2.5% dry	2.0% dry	2.0% dry	-	-	-
--	----------	----------	----------	---	---	---

density and moisture ratio results relate only to the soil to the depth of test and not to the full depth of the layer

Density Ratio (R_{HD})	%	98.0	98.0	101.0	-	-
---	---	-------------	-------------	--------------	---	---

Material description

No 25 - 27 Clay Fill

AVRLOT HILF V1.10 MAR 13



NATA Accredited Laboratory No 9909
 Accredited for compliance with
 ISO/IEC 17025 - Testing

Approved Signatory : Justin Fry